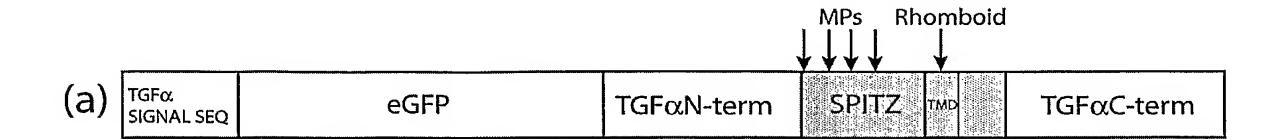
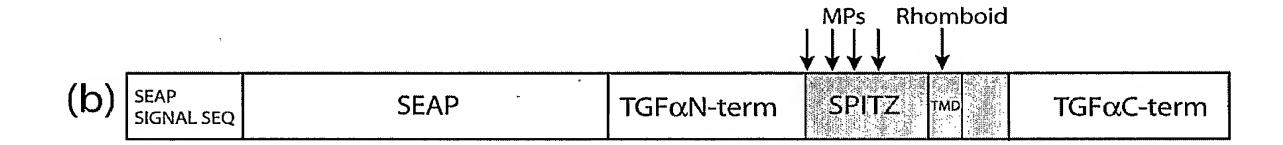
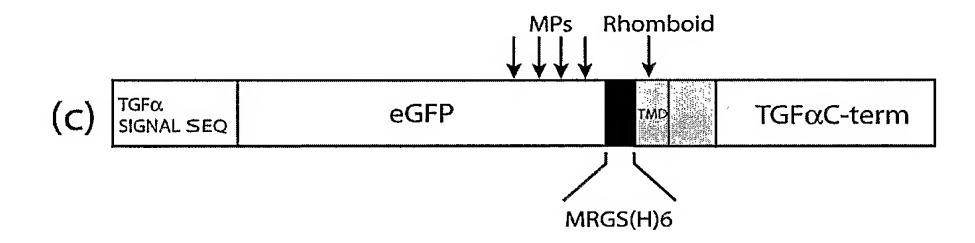
SPITZ/TGFα SUBSTRATE REPORTER CONSTRUCTS








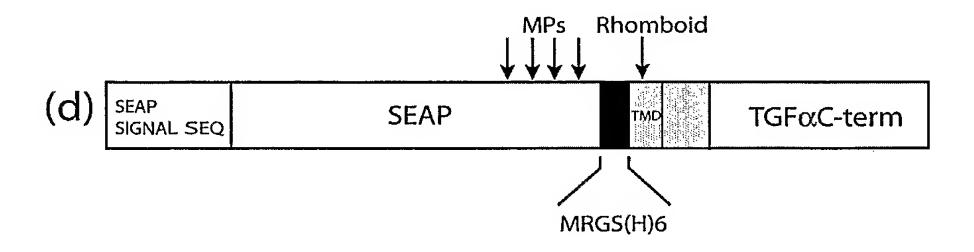


Figure 1

WO 2005/069011 PCT/GB2005/000154

(a) Substrate Cleavage by Metalloproteases vs. Rhomboids

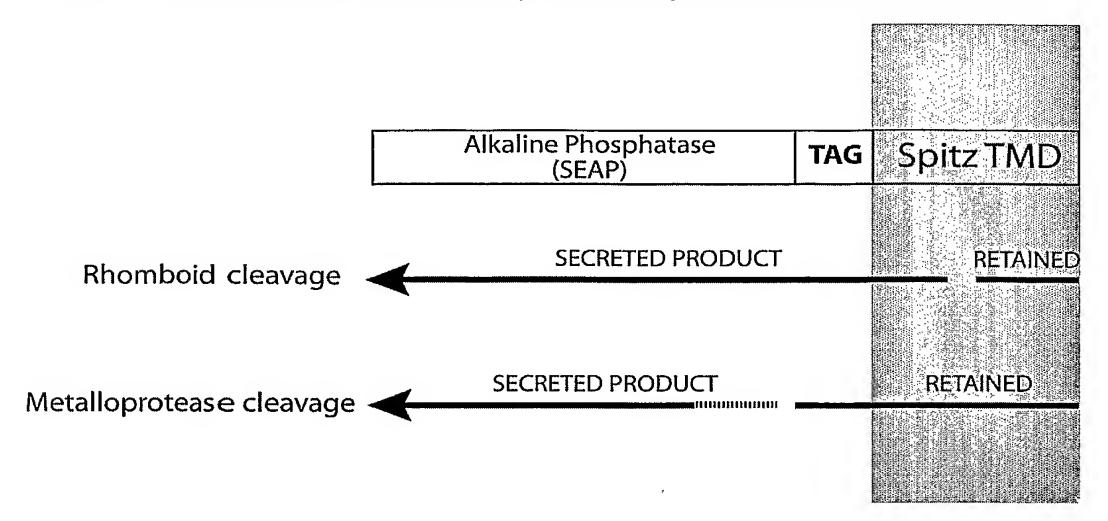

(b) Assay Principle

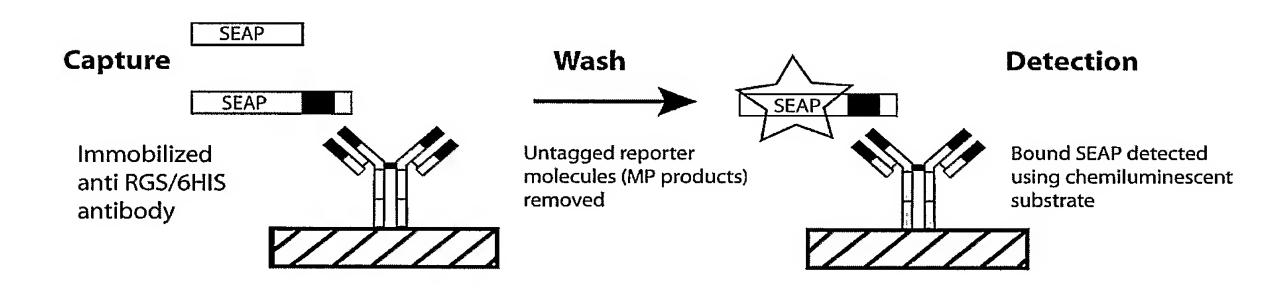


Figure 2


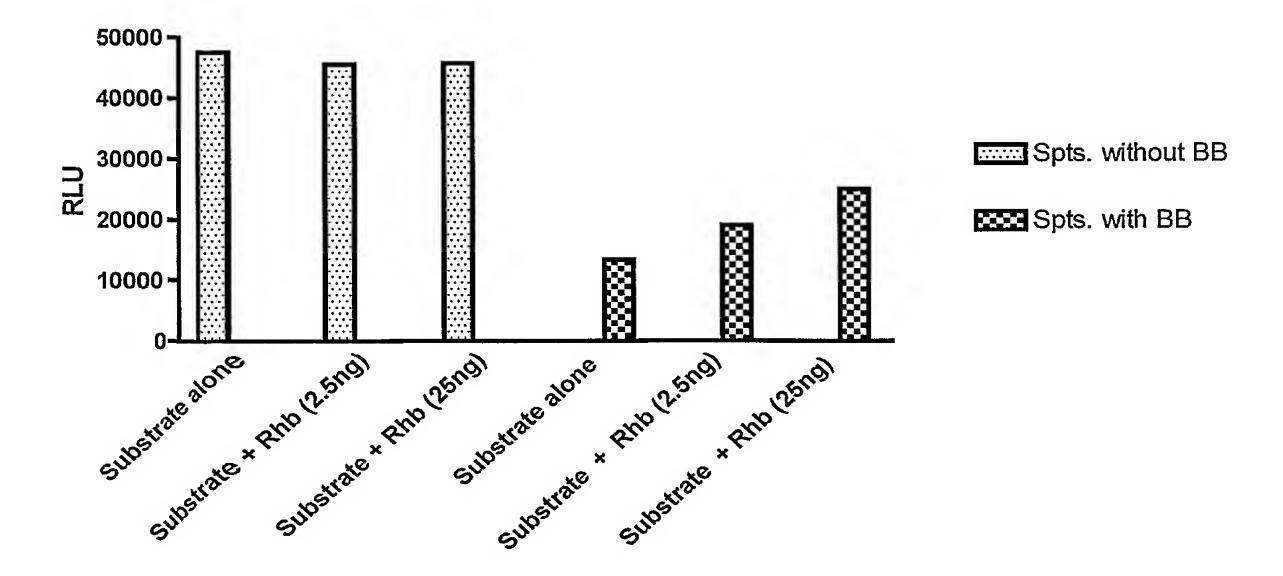


Figure 3

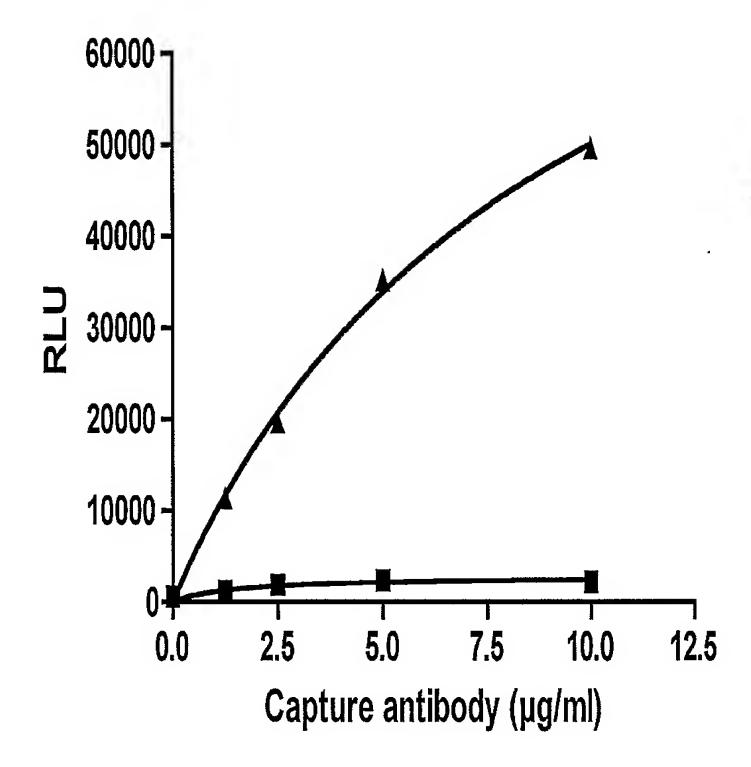

Construct(s) used to transfect Cos7

- Substrate alone
- ▲ Substrate + RHBDL2

Figure 4

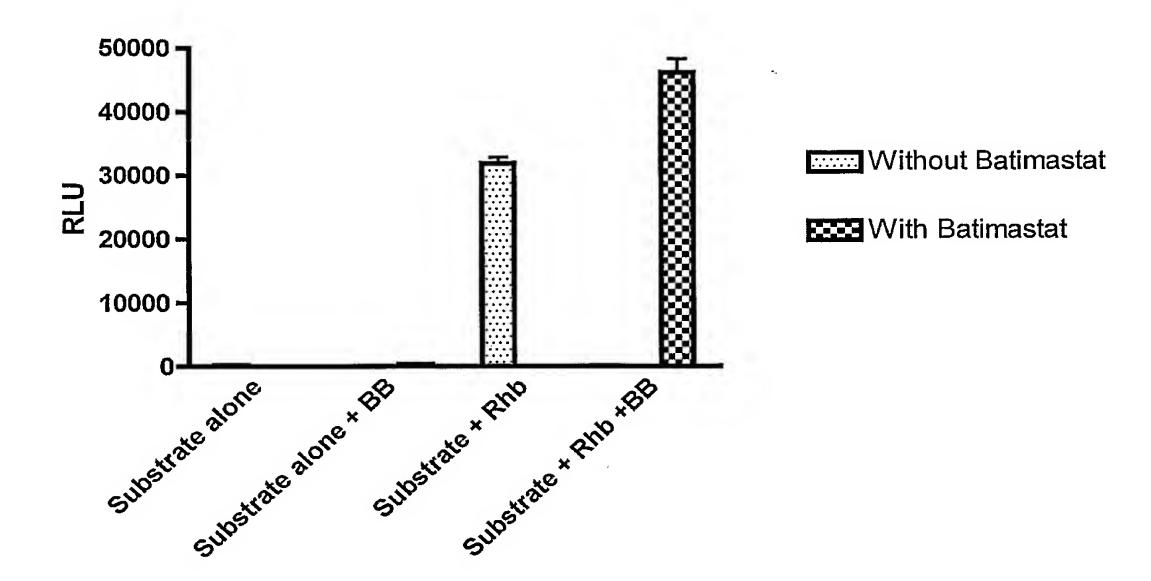


Figure 5